

# PERMIT

EXHIBIT

tabbles

"H"

City of Mt. Carmel

(Name of Operating Commission, City or State)

City of Mt. Carmel, 219 Market Street, Mt. Carmel, Illinois 62863

(Location)

Permission is hereby given to:

Mt. Carmel Public Utility

(Name of Firm or Individual)

316 Market Street; Mt. Carmel, IL 62863

(Address)

TO: (Describe in these spaces the proposal, including kind and type of construction purpose intended, location by stationing. Indicate passageway provided by means of gates, etc. Use separate sheets if necessary, identifying each by reference herein.)

SEE ATTACHED SHEET

Provided That:

Upon termination or expiration of this permit (whether by voluntary relinquishment by the permittee, by revocation by the permitter or otherwise) the permittee shall remove all structures, improvements, or appurtenances which may have been erected or constructed under this permit, and shall repair or replace any portion of the flood protection structure or right-of-way which may have been damaged by his operations (including grading and seeding, or sodding, if necessary), to the satisfaction of the permitter.

The structure or operation for which this permit is issued shall be maintained by the permittee in such manner as shall not injure or damage the flood protection structure, or interfere with its operation and maintenance in accordance with regulations of the Secretary of the Army.

The structure or operation covered by this permit may be damaged, removed or destroyed by the permitter in time of flood emergency if such action is determined by the permitter to be necessary in order to preserve life or property or prevent damage or impairment to the use or safety of the flood protection structure, and the permitter shall not be liable to the permittee for such damage or destruction.

Unless otherwise specifically provided herein, this permit may be cancelled at any time by the permitter upon 10 days written notice mailed to the address shown above. During such 10-day period, (or such other period as may be provided herein), the permittee will be permitted to remove any property or improvements installed under this permit, and to repair or replace any damage to the flood protection right-of-way or structures resulting from his use or operations. At the end of such period, the permitter shall have the right to possess and dispose of any such property or improvements remaining upon its right-of-way, and may proceed to repair or replace any such damage, and the permittee herein shall be liable to the permitter for the full cost of such repairs or replacements.

The construction, installation and maintenance of the structure or structures covered by this permit shall be subject to inspection by representatives of the permitter and the United States at all reasonable times.

In the event the work covered by this permit consists of or includes major construction, the cost of inspection thereof by the permitter and/or the United States shall be paid by the applicant.

Permittee agrees that it will not use the area or facilities covered by this permit, or permit such area to be used, for any purpose other than is specifically covered by this permit.  
(Use these spaces for special conditions applicable to this permit.)

PLEASE SEE ATTACHED SPECIAL CONDITIONS APPLICABLE TO THIS PERMIT

THIS PERMIT SHALL NOT BE VALID UNTIL APPROVED BY THE DISTRICT ENGINEER, CORPS OF ENGINEERS, U.S. ARMY, OR HIS AUTHORIZED REPRESENTATIVE.

Thomas W. Meeks  
Signature on behalf of local interest

MAYOR  
(Title)

4-11-04  
(Date)

Terms of this permit are hereby accepted.

E. S. V. P.

Signature (Permittee) Eric Bramlet

4-28-04  
(Date)

Vice-President, Mt. Carmel Public Utility Co.

Approved:

ROBERT A. ROWLETTE, JR.  
District Engineer  
Louisville District  
Corps of Engineers

05-28-04  
(Date)

By:

Robert G. Fuller  
ROBERT G. FULLER  
Chief, Operations Division


Mt. Carmel Public Utility Company  
Proposed New Transmission Line



This project consist of the construction of a new transmission line around the south and west side of the City of Mt. Carmel. The project begins at the exiting Division Street substation and terminates at the site of a new substation near the overhead bridge, north of Route 1.

The line will consist of a dual circuit line. One circuit will be 138,000 KV and the second circuit will be 69,000 KV. The minimum clearance over the top of the levee will be 20 feet. The levee will be spanned and there will not be any poles placed on the levee itself. The line will cross the levee at Sta. 23 + 65. The construction personnel will be required to cross the levee at various times during the construction. If any damage occurs it will be fixed to its original condition.

This work is expected to be completed in the fall of 2004. An actual date is unknown at this time due to unknown material delivery dates. The City will be notified at least 48 hours prior to any construction activities.

# Mt. Carmel Public Utility Proposed Transmission Line Levee Crossing

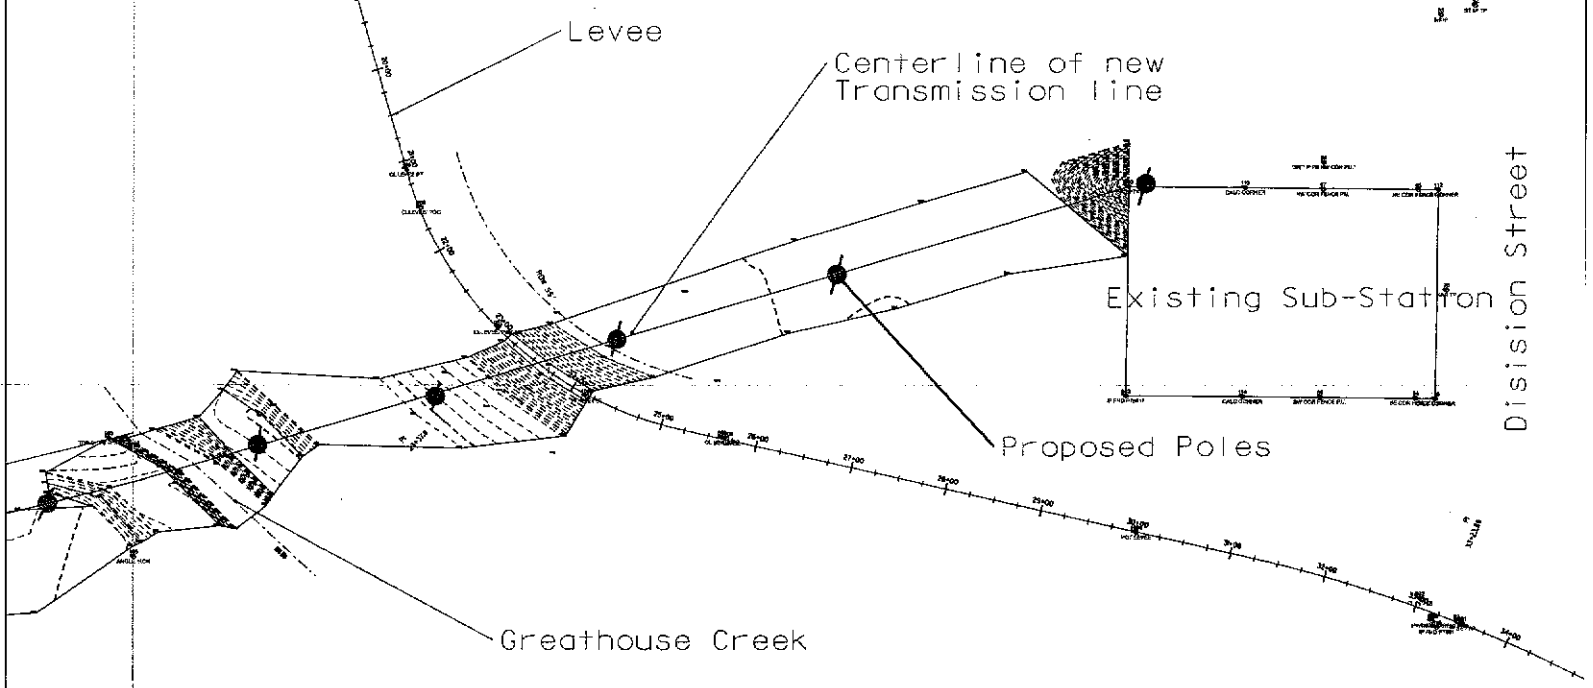

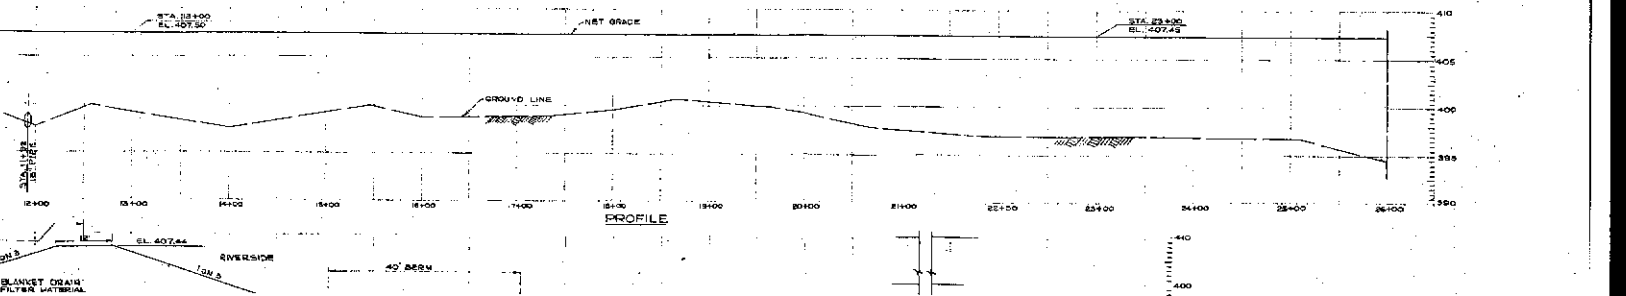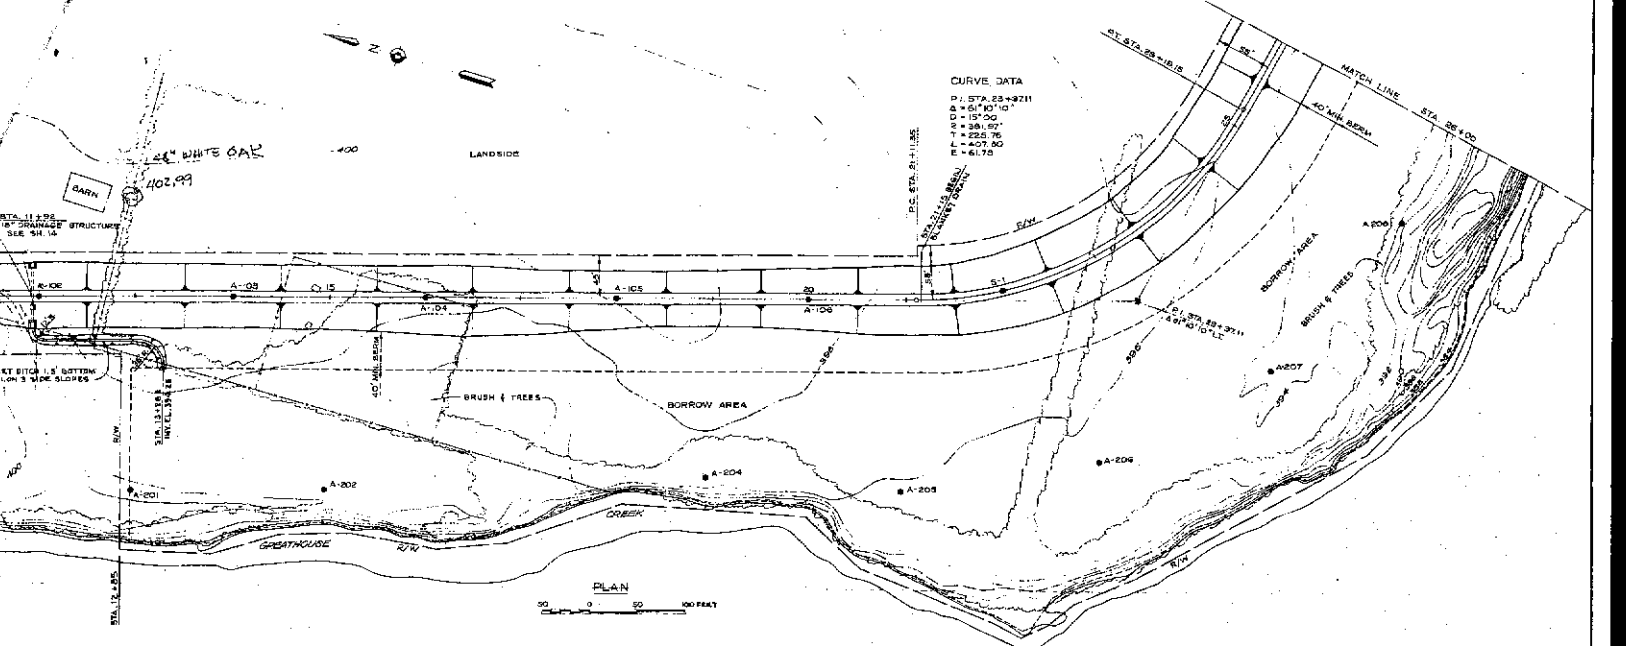

Special conditions for the permit for the construction of an electrical transmission line which will cross the Mount Carmel Flood Protection Project at Station 23+65 are as follows:

1. The minimum clearance of the electrical line over the top of the levee shall be 25 feet in accordance with ANSI C2-2002, NESC, Rule 232.

2. There will not be any electrical poles placed within 20 feet of the levee toe on either side.

3. The levee shall be restored to it's original condition upon completion of the project.